



Applies to HE, HE+, SE, and Sensei Models

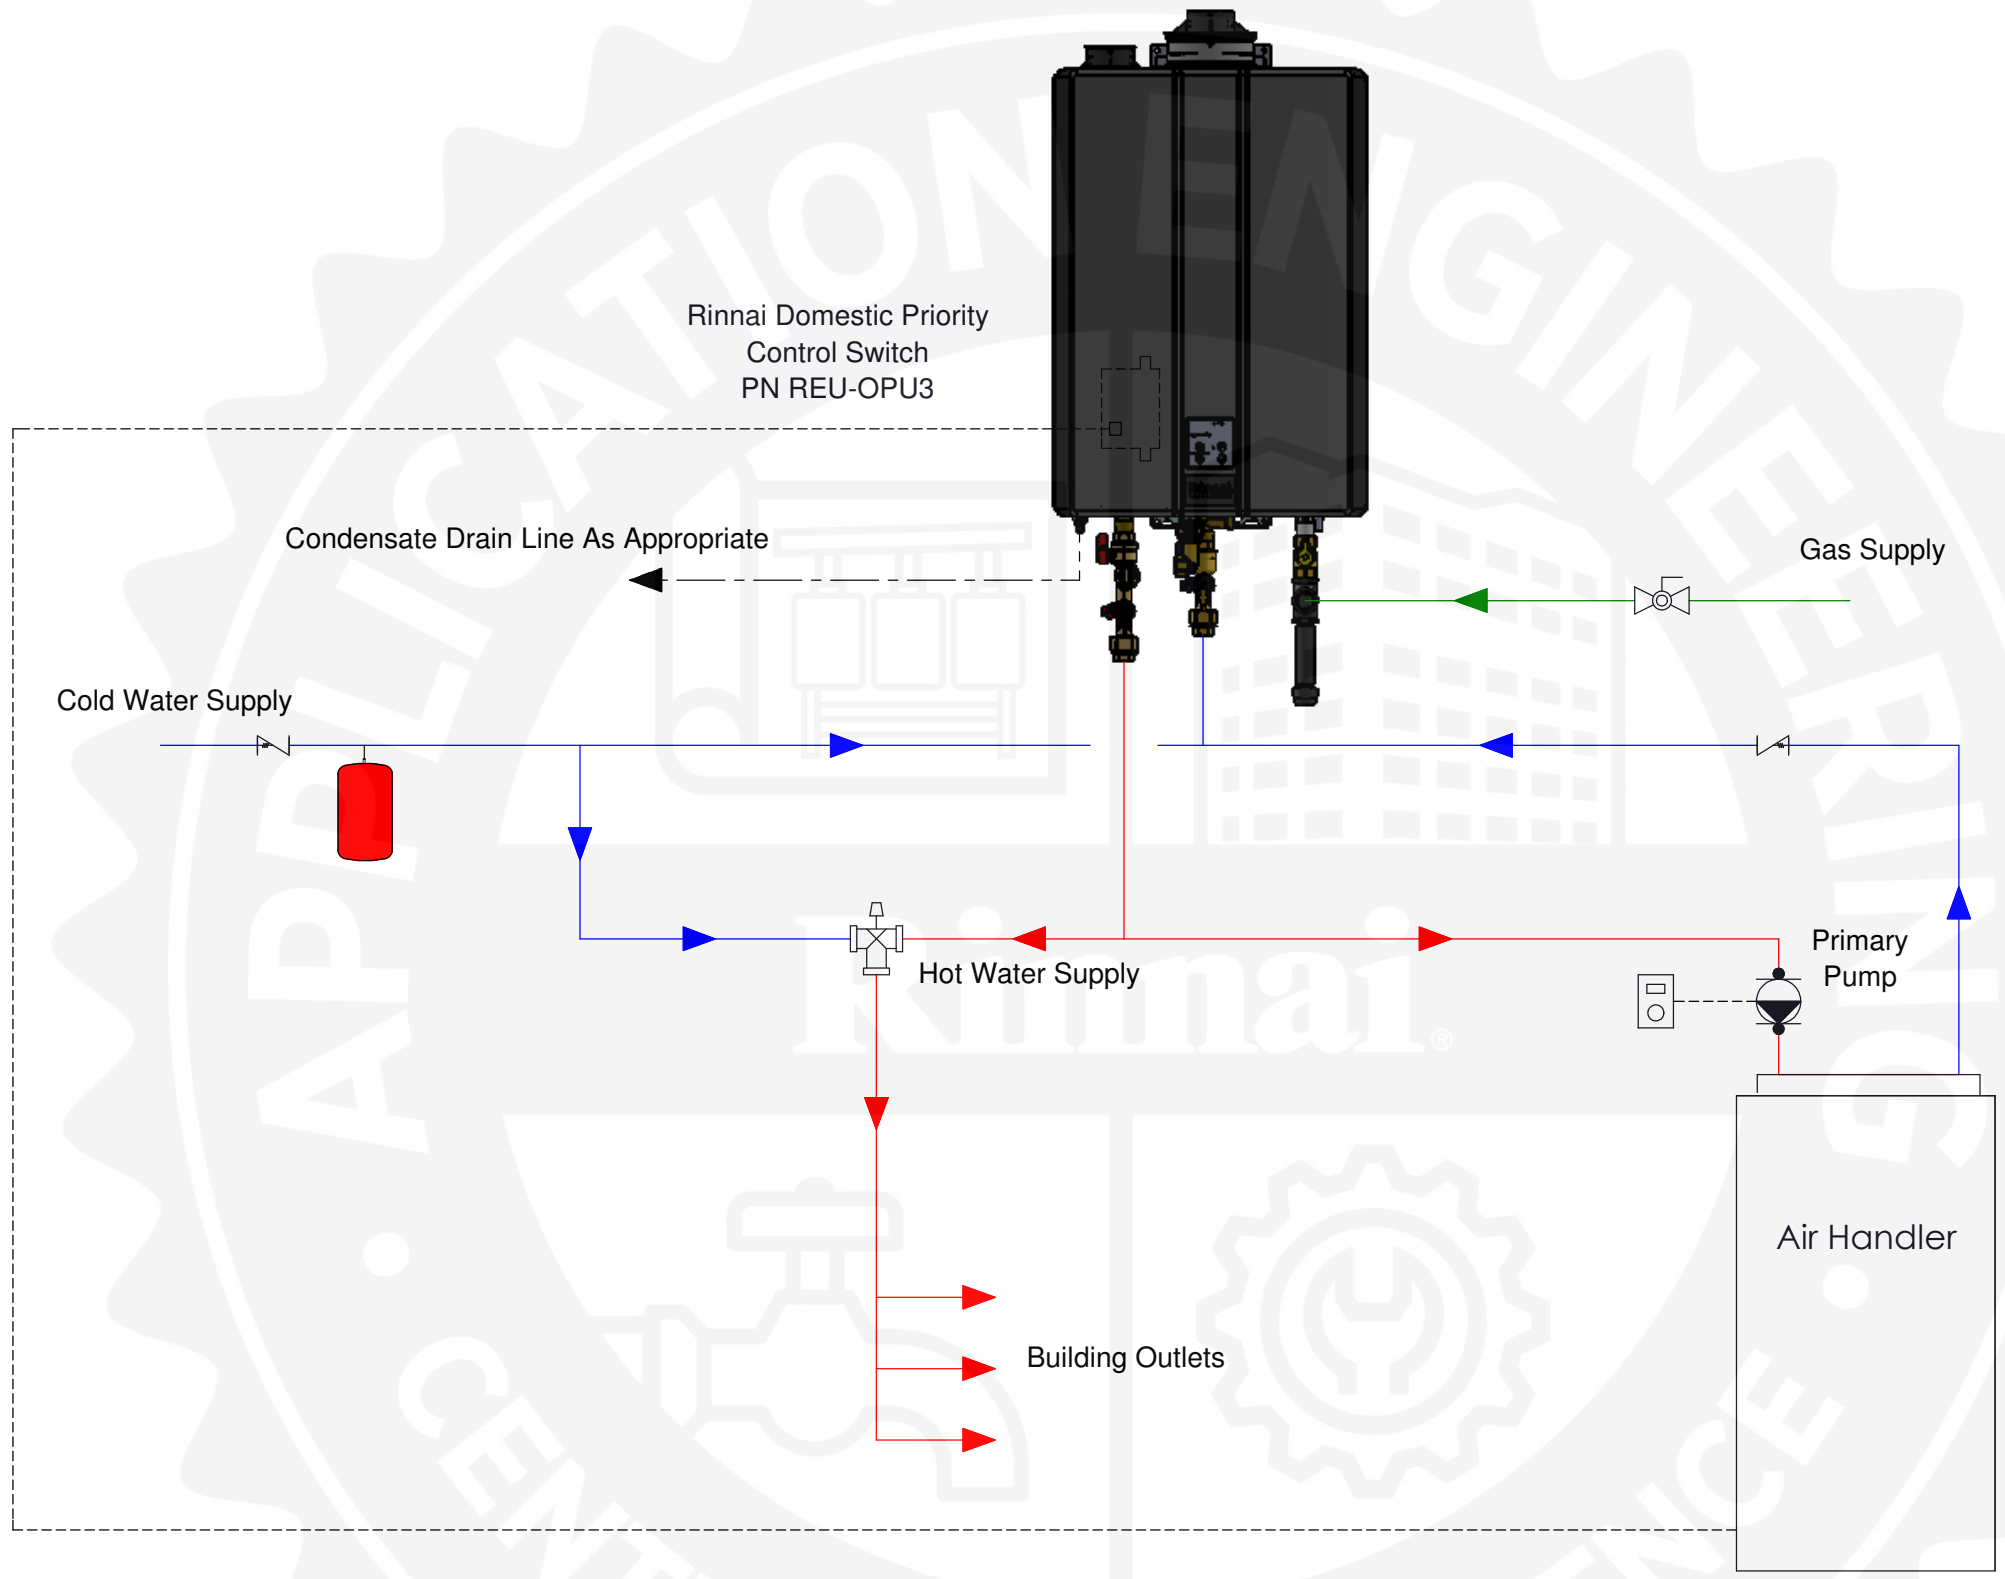

Primary Pump:
 Pump must be sized for the flow rate of the heating system. Pump must also be sized to overcome pressure loss through the system at the desired flow rate. Refer to the IO Manual for the model's pressure loss curve. Pump to be of bronze or stainless construction.

D
C
B
A

D
C
B
A



This is not an engineering drawing; it is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

RINNAI AMERICA CORPORATION
 103 INTERNATIONAL DRIVE
 PEACHTREE CITY, GA 30269
 1-800-621-9419

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF RINNAI AMERICA. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF RINNAI AMERICA IS PROHIBITED.

UNLESS OTHERWISE SPECIFIED:

TOLERANCES:
 Sheet Metal X.XX = ±0.030
 X.XXX = ±0.010
 Fraction = ±1/32
 Angle = ± 1.0°
 MACHINED X.XXX = ±0.005
 Angle = ± 0.010°

INTERPRET GEOMETRIC TOLERANCING PER:

MATERIAL

FINISH

DO NOT SCALE DRAWING

| | NAME | DATE |
|-----------|------|------------|
| DRAWN | AB | 11.16.2018 |
| CHECKED | SH | 12.15.2018 |
| ENG APPR. | RS | 12.15.2018 |

COMMENTS:



TITLE:
Systems Design Manual

Rinnai Tankless
 Generic Air Handler

SIZE DWG. NO. REV

B WH1-AH

SCALE: NTS WEIGHT: SHEET 1 OF 1