


Applies to HE, HE+, SE, and Sensei Models

Primary Pump

Pump must be sized for the flow rate of the heating system. Pump must also be sized to overcome pressure loss through the system at the desired flow rate. Refer to the Operation and Installation Manual for the model's pressure loss curve. To be of bronze or stainless construction.

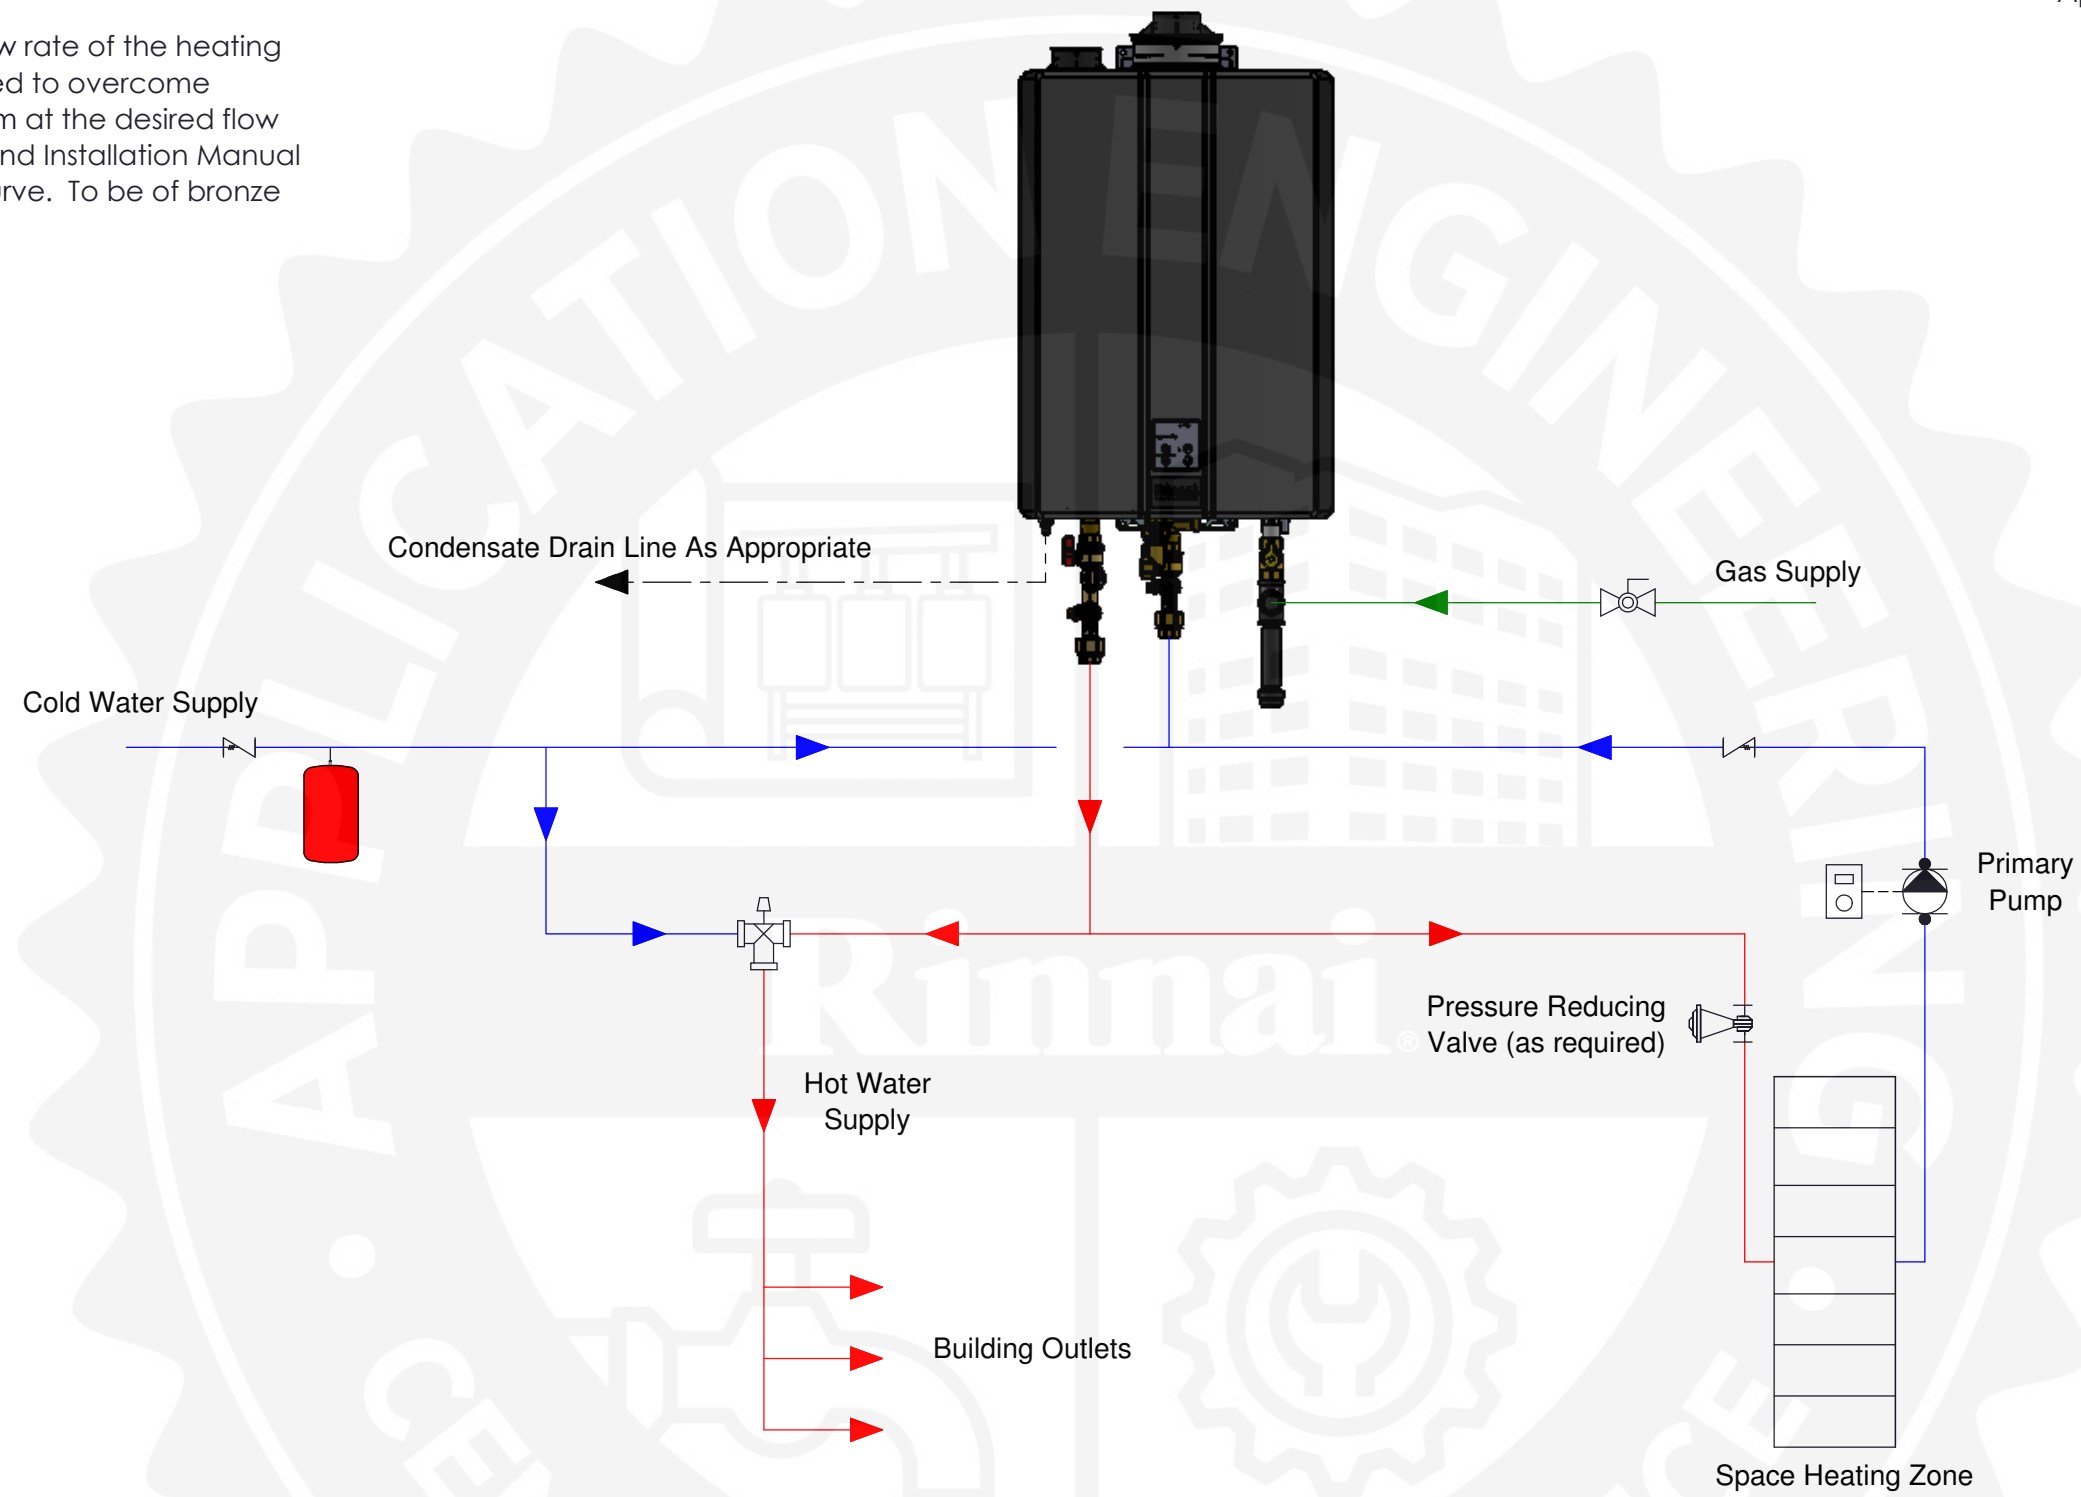

This is not an engineering drawing; it is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

UNLESS OTHERWISE SPECIFIED:

TOLERANCES:
 Sheet Metal X.XX = ±0.030
 X.XXX = ±0.010
 Fraction = ±1/32
 Angle = ± 1.0°
 MACHINED X.XXX = ±0.005
 Angle = ± 0.010°

INTERPRET GEOMETRIC TOLERANCING PER:

MATERIAL

FINISH

DO NOT SCALE DRAWING

	NAME	DATE
DRAWN	AB	11.16.2018
CHECKED	SH	12.15.2018
ENG APPR.	RS	12.15.2018

COMMENTS:

RINNAI AMERICA CORPORATION
 103 INTERNATIONAL DRIVE
 PEACHTREE CITY, GA 30269
 1-800-621-9419

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF RINNAI AMERICA. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF RINNAI AMERICA IS PROHIBITED.



TITLE:
Systems Design Manual
 Rinnai Tankless
 Hydronic Heating

SIZE	DWG. NO.	REV
B	WH1-SH	
SCALE: NTS	WEIGHT:	SHEET 1 OF 1